

**Document Links:**

[Sepsis Instrument](#)

**REVSTAT**

REVIEW STATUS (not abstracted)  
 0. Abstraction has not begun  
 1. Abstraction in progress  
 2. Abstraction completed w/o errors  
 3. Cohort validation failure (exclusion)  
 4. Record contains missing data  
 5. Administrative exclusion from all measures

**AGE**

Calculated field – ADMDT - BIRTHDT

**DCDT**


Discharge date


**LACTATE**

During the timeframe from (computer display sepresdt/seprestm - 6 hours to sepresdt/seprestm + 3 hours) was an initial lactate level drawn (or collected)?  
 1. Yes  
 2. No

**LACVAL**

What initial lactate level result was documented in the record?  
 1.  $\leq 2$  mmol/L (less than or equal to 2 mmol/L)  
 2.  $> 2$  and  $< 4.0$  mmol/L (greater than 2 mmol/L and less than 4 mmol/L)  
 3.  $\geq 4$  mmol/L (4 mmol/L or greater)  
 99. Initial lactate result was not documented or unable to determine result

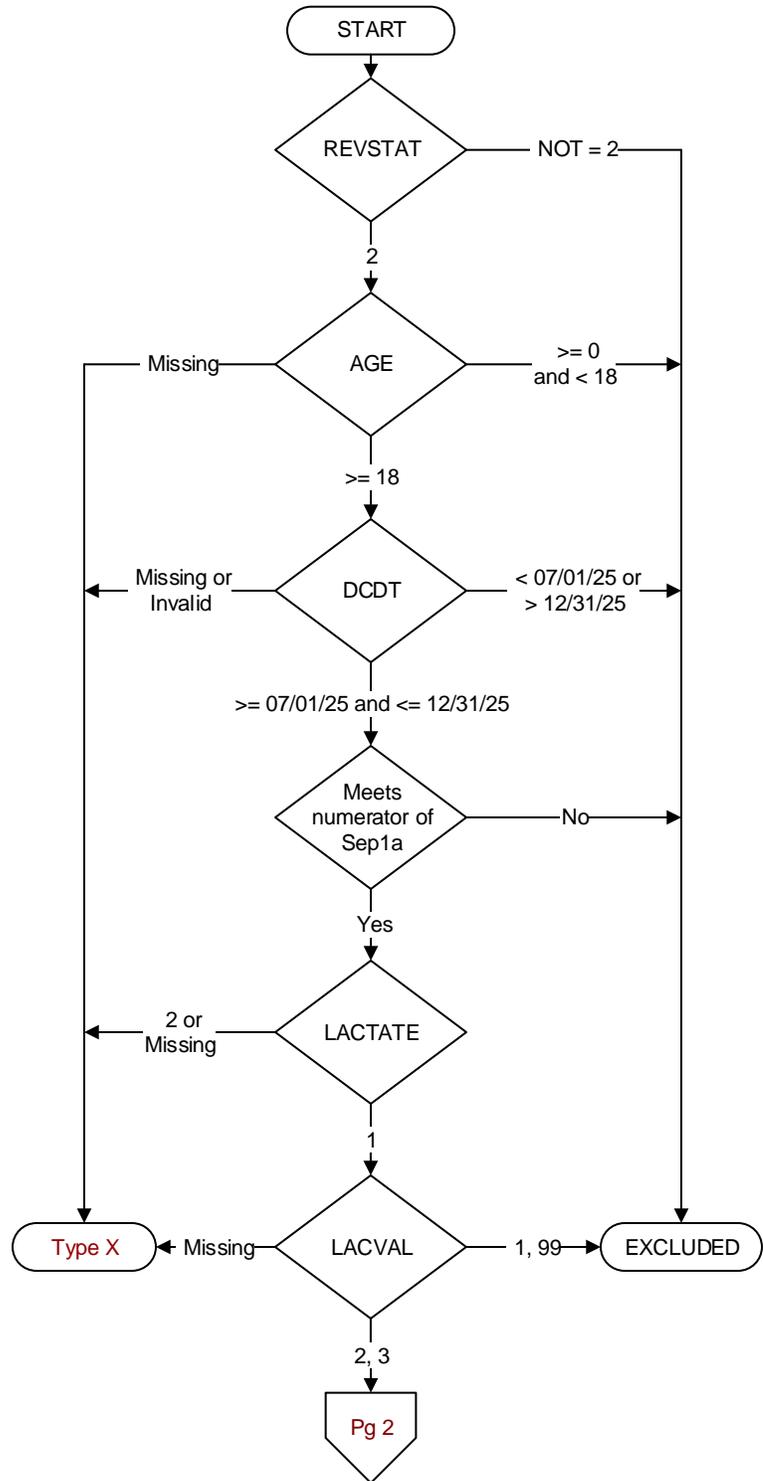

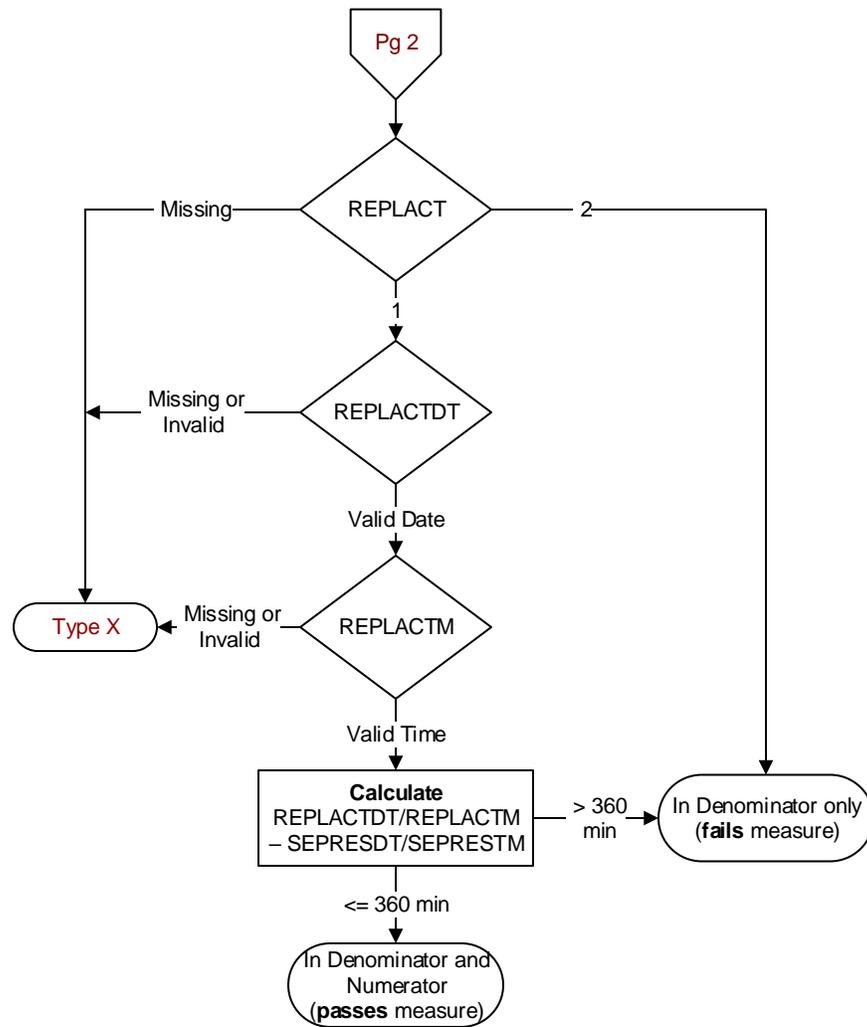

**REPLACT**  
 During the timeframe from (computer display sepresdt/seprestm to sepresdt/seprestm +6 hours) was a repeat lactate level drawn?  
 1. Yes  
 2. No

**SEPRESDT**  
 Computer to auto-fill earliest valid date entered in sepd2, shkdt, or sepsisd.

**REPLACTDT / REPLACTM**  
 During the timeframe from (computer to display lacdt/lactm to sepresdt/seprestm + 6 hours), enter the earliest date and time the repeat lactate level was drawn (or collected).

**SEPRESTM**  
 Computer to auto-fill earliest valid time entered in sepm2, shktm, or sepsistm.